


THE MINIMUM SIZE OF BROKEN CONCRETE OR RUBBLE STONE USED IN THE CONSTRUCTION OF THE TREE WELLS SHALL BE 4" IN THICKNESS AND 6" IN LENGTH AND WIDTH. HEIGHT OF WELL DEPENDS ON SLOPE AND DEPTH OF FILL. FOR PAYMENT PURPOSES THE HORIZONTAL THICKNESS OF THE STONE OR CONCRETE SHALL BE CONSIDERED AS 12" .

PLACE A LAYER OF BEDDING STONE, IN ACCORDANCE WITH THE SPECIAL PROVISIONS, OVER THE ENTIRE AREA UNDER THE TREE FROM THE WELL TO THE LIMIT OF THE DRIP LINE OR AS DETERMINED BY THE ENGINEER.

DO NOT USE LIMESTONE.

OMIT THE DRAIN TILE IF THE DISTANCE FROM THE TREE TO THE TOE OF SLOPE IS MORE THAN 20' OR LESS THAN 5'.

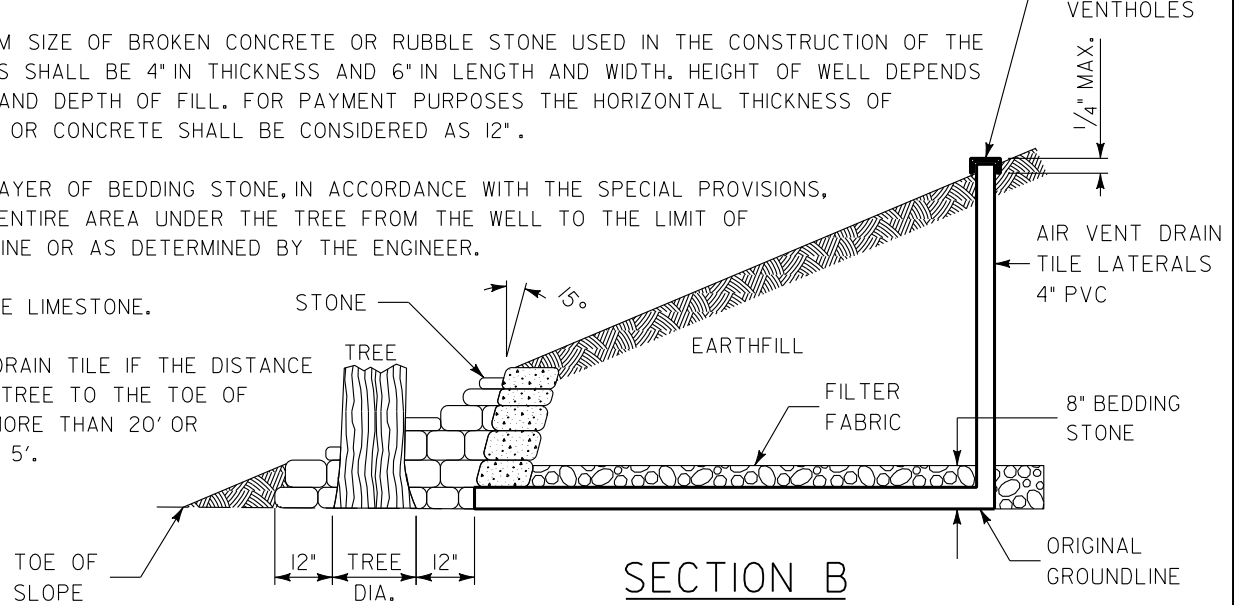

APPROXIMATE DRIP LINE DIA. BASED ON TRUNK DIAMETER	
TREE DIAMETER (INCHES)	DRIP LINE (FEET)
0-2	2
3-4	4
5-9	10
10-14	20
15-19	24
OVER 19	30

NOT TO SCALE

REVISIONS	DATE



APPROVED BY: M. G. ZEMAITIS  
DATE: APRIL 1, 2007

**DRY RUBBLE STONE OR  
BROKEN CONCRETE  
TREE WELLS**

LC2100